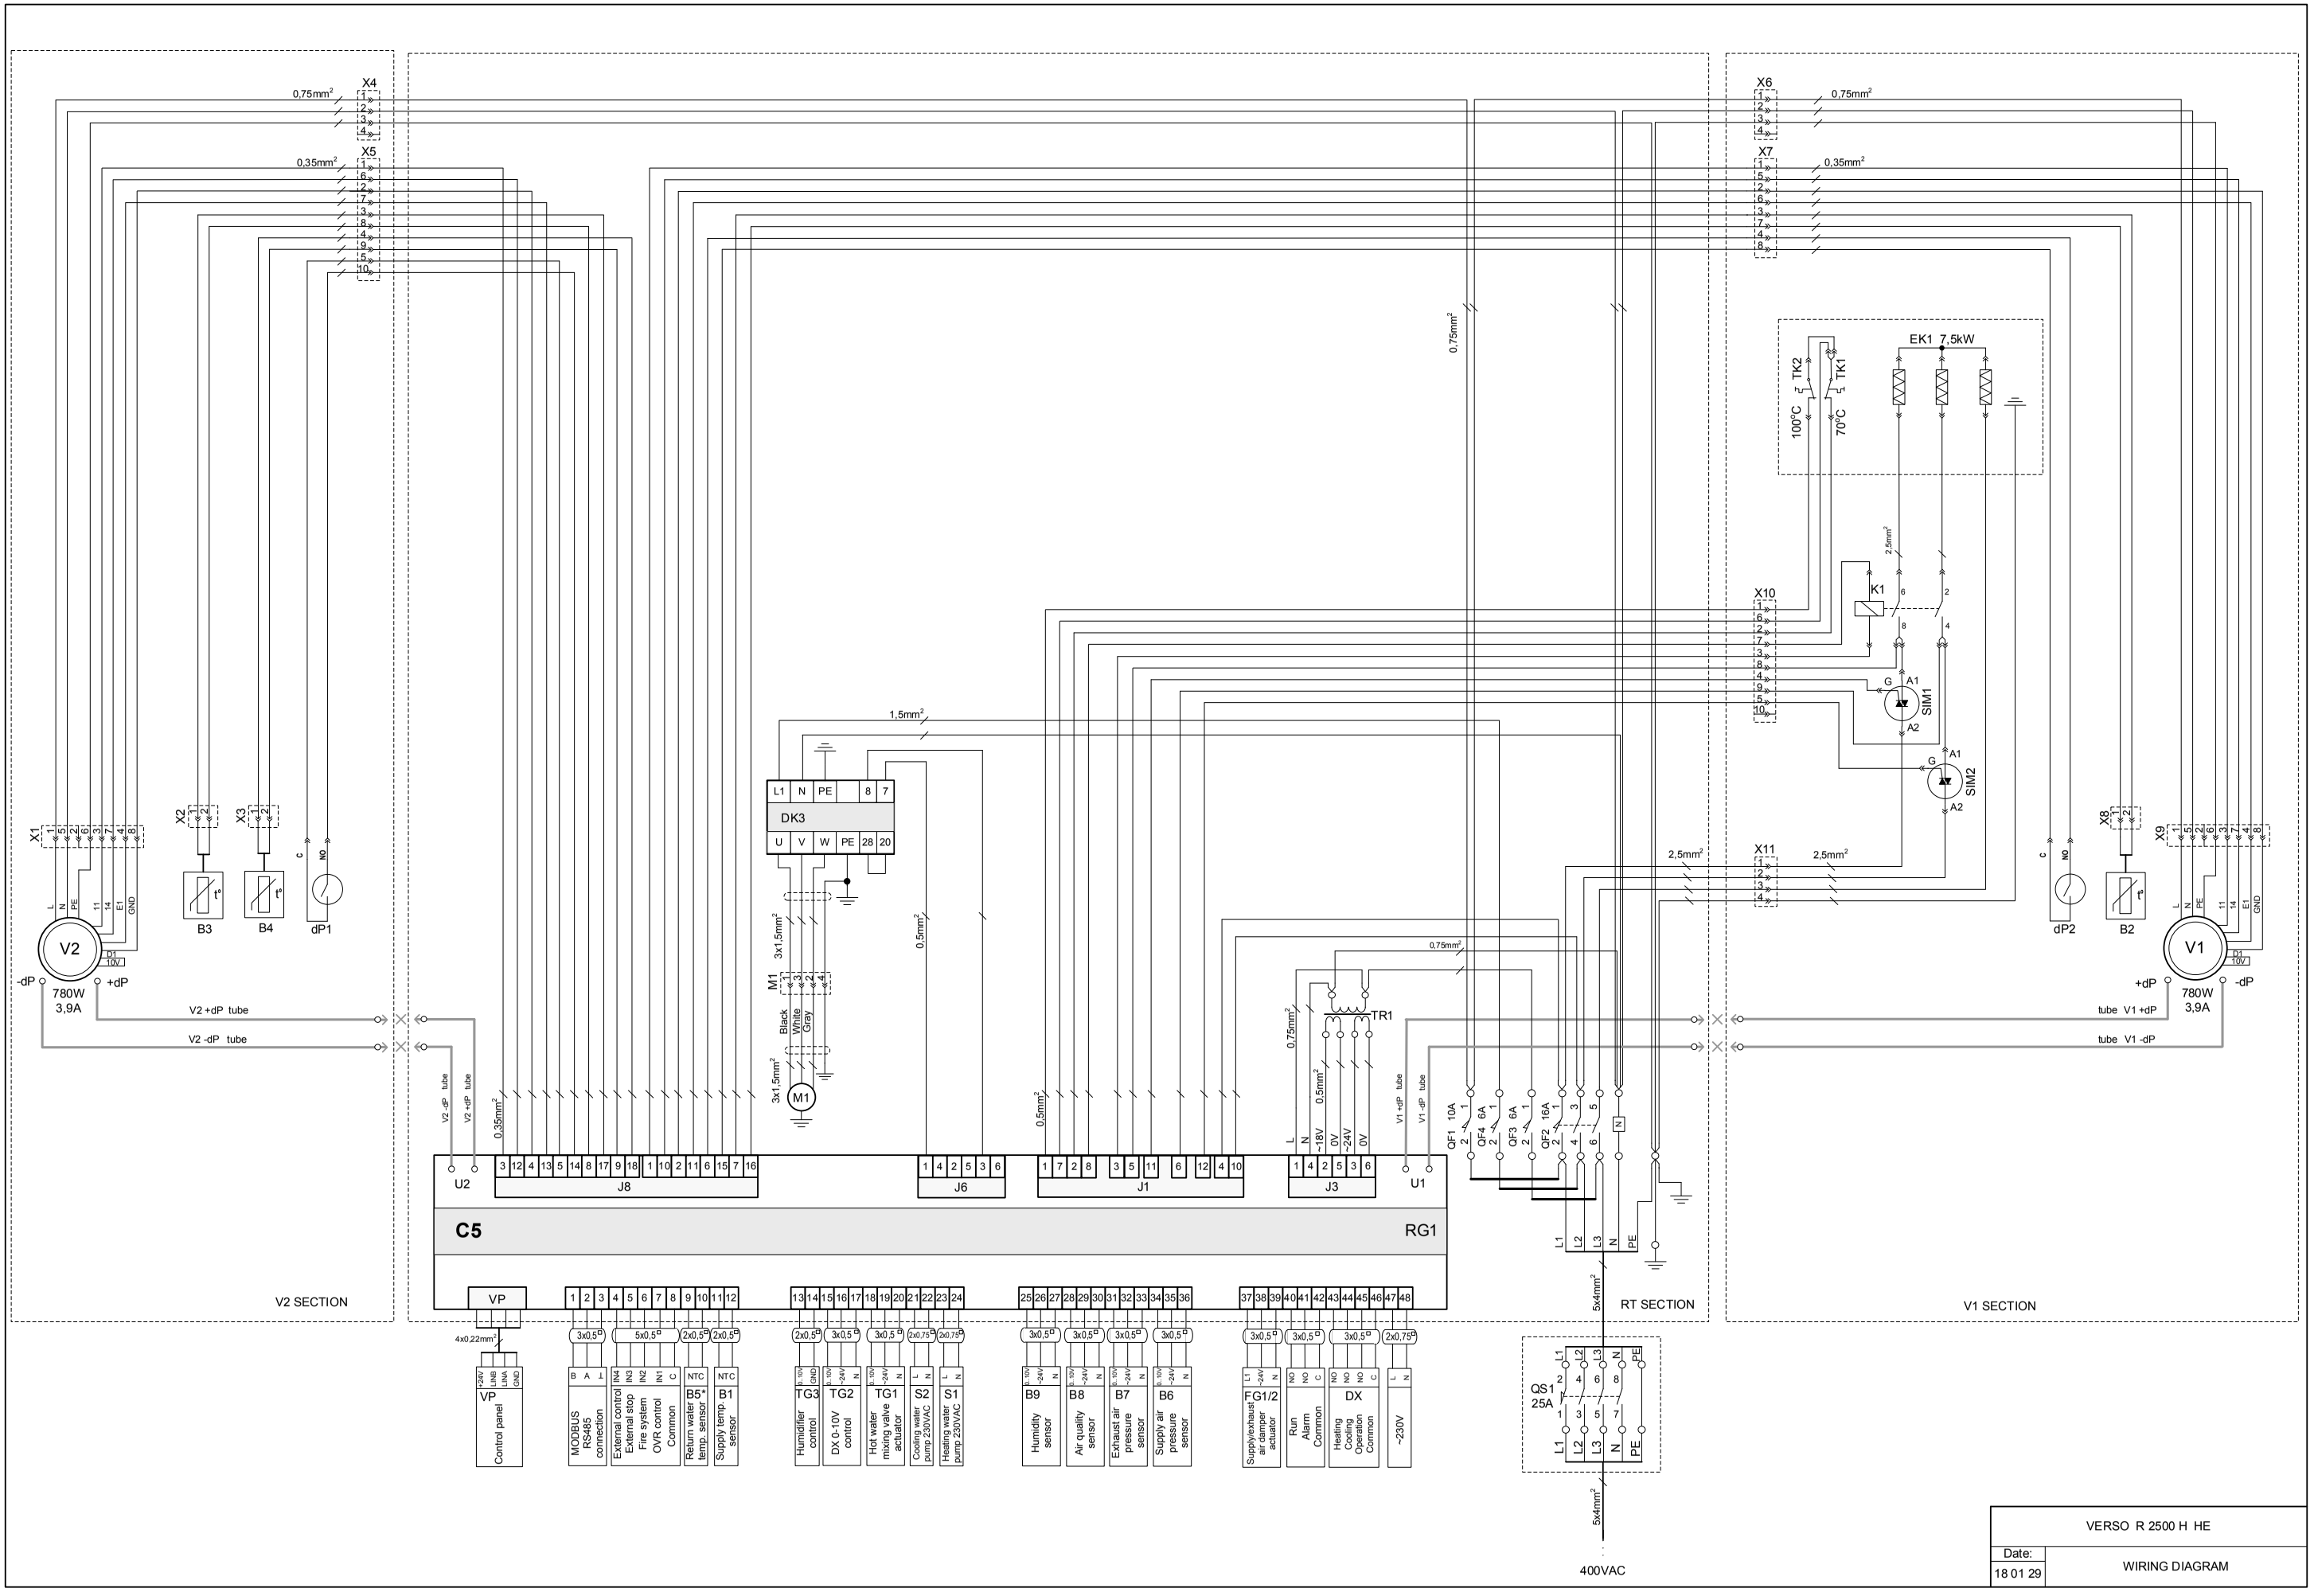
V2 SECTION
RT SECTION
V1 SECTION
C5
RG1
VERSO R 2500 H HE
Date:
18 01 29
WIRING DIAGRAM
400VAC
QS1 25A
EK1 7,5kW
TK2 100°C
TK1 70°C
K1
SIM1
SIM2
TR1
M1
DK3
V2 780W 3,9A
V1 780W 3,9A
V2 +dP tube
V2 -dP tube
tube V1 +dP
tube V1 -dP
VP Control panel
MODBUS RS485 connection
External control
External stop
Fire system
OVR control
Common
Return water temp. sensor
Supply temp. sensor
Humidifier control
DX 0-10V control
Hot water mixing valve actuator
Cooling water pump 230VAC
Heating water pump 230VAC
Humidity sensor
Air quality sensor
Exhaust air pressure sensor
Supply air pressure sensor
Supply/exhaust air damper actuator
Run Alarm Common
Heating Cooling Operation Common
~230V